

TransmitterSOLUTIONS®
SMART

Contents

Installation Instructions	3
Installation Diagrams	4
System Overview	6
Wiring Diagrams	8
Network Diagrams	9
Operating Instructions	12
Fingerprint Enrollment	19



Wi-Plus Controller

Technical Specs - GSD Wi-Plus Controller

Power Supply	12 DC
Current consumption	120mA
Current consumption with load (max)	160mA
Relay Contact Rating	5 Amps / 240V ac
Moisture Resistance	Indoor Use Only
Dimensions	W. 135mm D. 46mm H. 200mm

Technical Specs - Wi-Plus Door Controls

Power Supply	12 DC
Current consumption	110mA
Current consumption with load (max)	145mA
Relay Contact Rating	5 Amps / 240V ac
Operating Temperature	- 20°C to +60°C
Moisture Resistance	IP 67 (IP65 on Wi-Bio)
Dimensions - Flush Mount	W. 87mm D. 21mm H. 119mm
- Surface Mount	W. 87mm D. 35mm H. 119mm

Features


Doors controlled	10
Users	5000
User Groups	16
Time Zones	16
Door Groups	16
Reporting Facility	Yes
Challenge Facility	Yes
Logging	Unlimited
Input/Output Mapping	CCTV & Lift control
Supports Wireless & RS485 Networks	Yes
Automatic Backup Facility	Yes
Database Encryption	Yes

Incorrect Finger Placement



Note: Incorrect placement : finger does not fully cover the sensor window. The door control will not respond and the red light will not turn off if the sensor window is not fully covered by the finger.

Correct Finger Placement



✓
Correct


Note: Ensure that the finger is centered and placed flat to the surface and fully covers the sensor window.

Note: Finger must remain on the sensor window until the door control acknowledges that the finger has been scanned by sounding a beep and turning off the red light. This will take approximately 1 second.


Installation Steps

Step	Description	Page
1	Install the Controller using the Installation Diagrams	4-5
2	System Overview	6-7
3	Wire the Controller using the Wiring Diagrams	8
4	Install and wire each Door Control. Refer to the Door Control Manual for instructions.	
5	Connect the Controller to the PC using Network Diagrams	9-11
6	Restoring Factory Defaults	11
7	Phase 1- Setting up the Controller via the PC application	12
8	Phase 2 - Configuring the Controller via the PC application	13
9	Phase 3 - Defaulting Door Controls	14
10	Phase 4 - Enrolling Door Controls	15-16
11	Phase 5 - Configuring Users	17
12	Phase 6 - Configuring Access Levels	18
13	Phase 7 - Downloading Configuration	18
14	Enrolling User Fingerprints	19
15	Correct Finger Placement techniques	20-23

1. To open front cover of TS SMART Controller, remove screw cap using screwdriver then loosen screw.

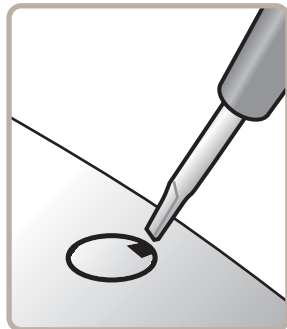


2. Remove door from unit (see inset) before screwing the rear enclosure to the wall.

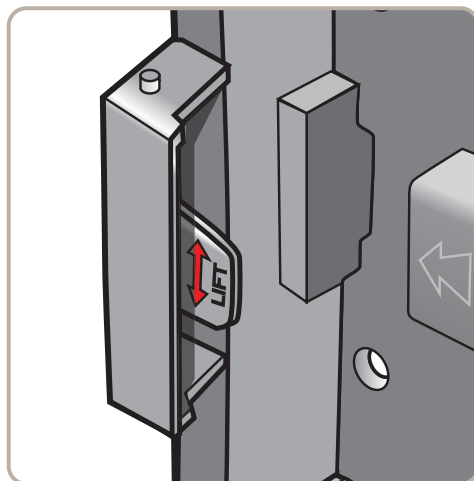


To remove front cover lift tab up and unhook door.

4. Re-attach the front cover

To re-attach front cover: hook door over top pip and rotate into position and push tab down to secure.

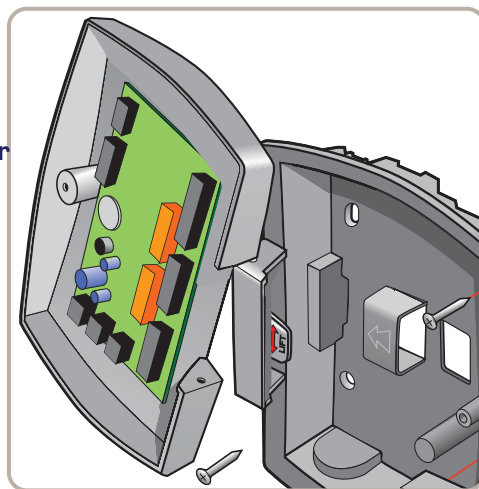

Incorrect Finger Placement

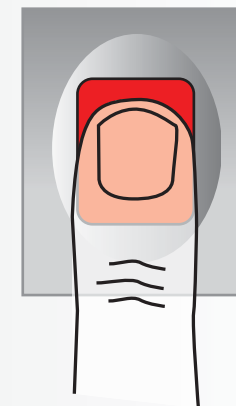

Note: Incorrect placement : finger does not fully cover the sensor window.



X Poor Quality Image

Note: Poor Quality image, No Fingerprint core on sensor window.

This can result in poor template quality that can lead to false rejection issues later when the user is trying to gain access.



Correct Finger Placement

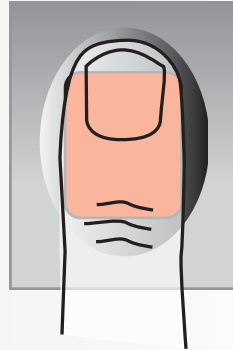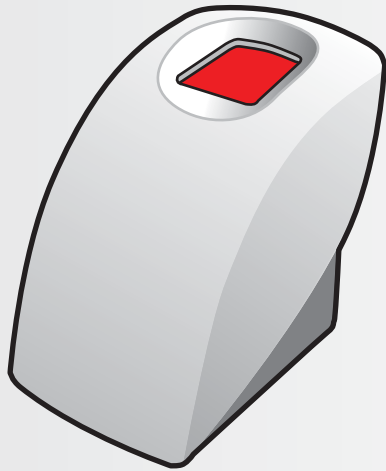


Good Quality Image


Note: Ensure that the core of finger is centered on the sensor window during the enrollment process. This will increase the quality of the fingerprint template. Ensure a value of at least 90% is achieved.

Note: Good Quality image, Fingerprint core is center of sensor window


Note: The System does not store the finger print. It uses an algorithm to generate a binary representation using sample points from the fingerprint. It uses this information to then validate each users fingerprint.

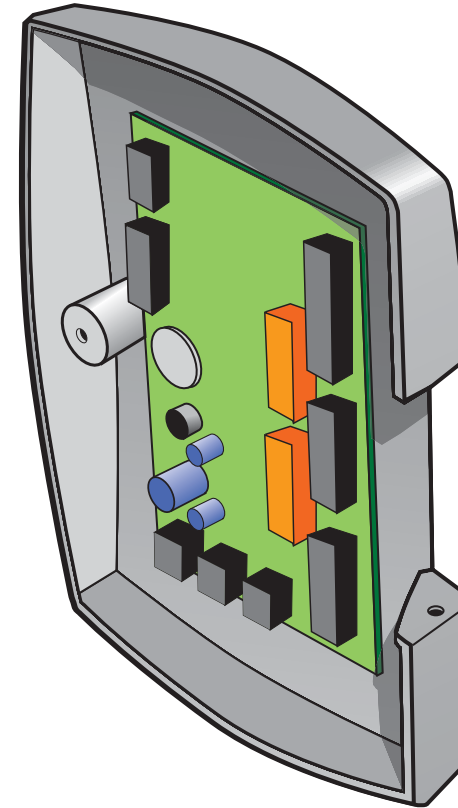

3. screw the rear enclosure to the wall.
as shown below.

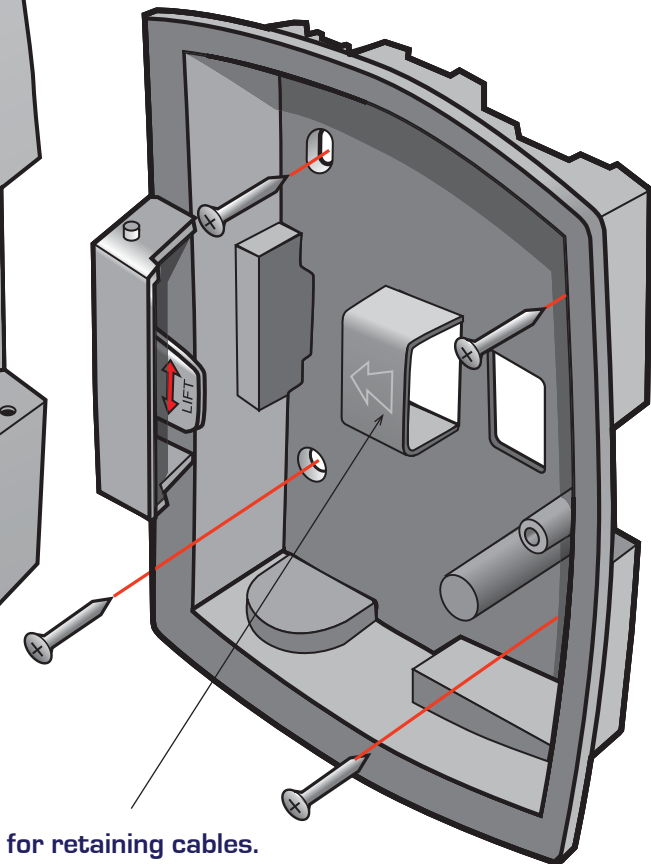

RS485 Connection to Door Controls

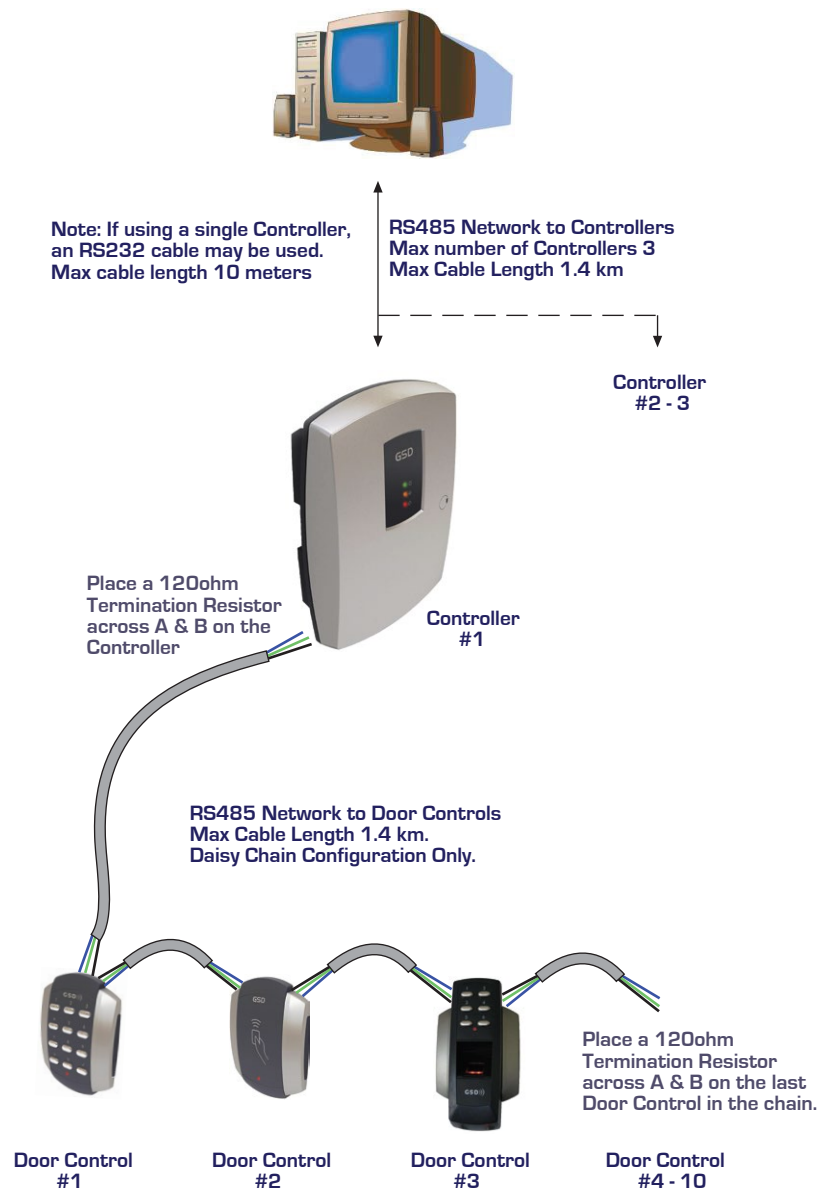

Enrolling User Fingerprints

Step	Description
	Note: Make sure the USB Fingerprint reader is attached to the PC
1.	On the Users Tab , Select a User for fingerprint enrolment
2.	Click on the 'Fingerprints' button.
3.	Click on '+' button to begin and place finger on the enrolment reader. An image of the fingerprint will appear on the screen. Ensure that the image quality is good and a value of at least 90% is achieved. Refer to section 'Finger Placement' for correct finger placement and example of good quality image. Repeat this process if this is not achieved on first attempt. Two fingerprint templates can be saved for each user.
4.	Click 'Save' using a good quality template only. Poor Quality templates can lead to false rejections later when trying to gain access .


Phase 6 - Configuring Access Levels

Step	Description
	Access Levels are controlled by creating UserGroups and assigning the UserGroup to a User as described in section 'Configuring Users'.
1.	UserGroups are created by combining pairs of DoorGroups with Timezones . Each UserGroup can have up to 6 pairs of DoorGroups and Timezones. Select DoorGroups and Timezones from the drop-down menus to add to the current UserGroup.
2.	Timezones are the periods of time for each day of the week that access will be granted. Select times and tick the days of the week this time is valid. 4 time periods can be created for each timezone. Select 'Holiday Access' to grant access for holiday periods. Double click on the 'Holiday Access' to add days to the holiday periods. Use the calendar to select these days.
3.	DoorGroups are created by grouping doors together. e.g. all the entry and exit doors could be grouped together as 'Perimeter Doors'. Select a Door from the 'All Available Doors' window and drag it to the 'Doors in Current Group' to add it to the Door Group. Repeat for adding doors as desired.


Phase 7 - Downloading Configuration

Step	Description
	After all users, access levels and door control settings have been finalised, a full download to the controller should be carried out.
1.	Go to the 'Settings' tab and click on 'Download Configuration'. A pop-up window will appear, tracking the status of the download. All settings will be downloaded to the Controller and Door Controls.

Wireless Connection to Door Controls

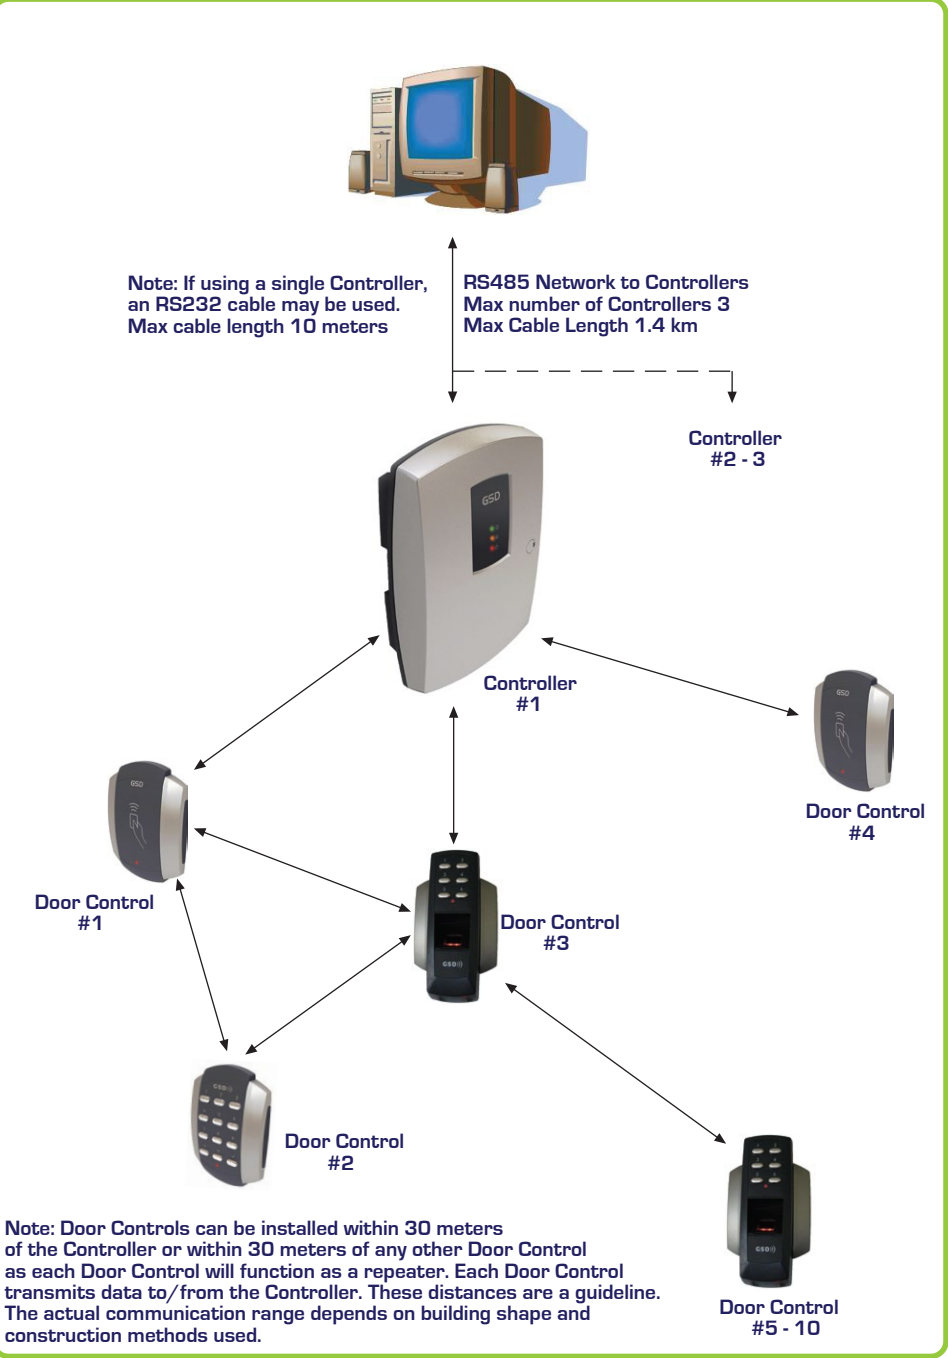

Wiring Diagrams with Fire Alarm

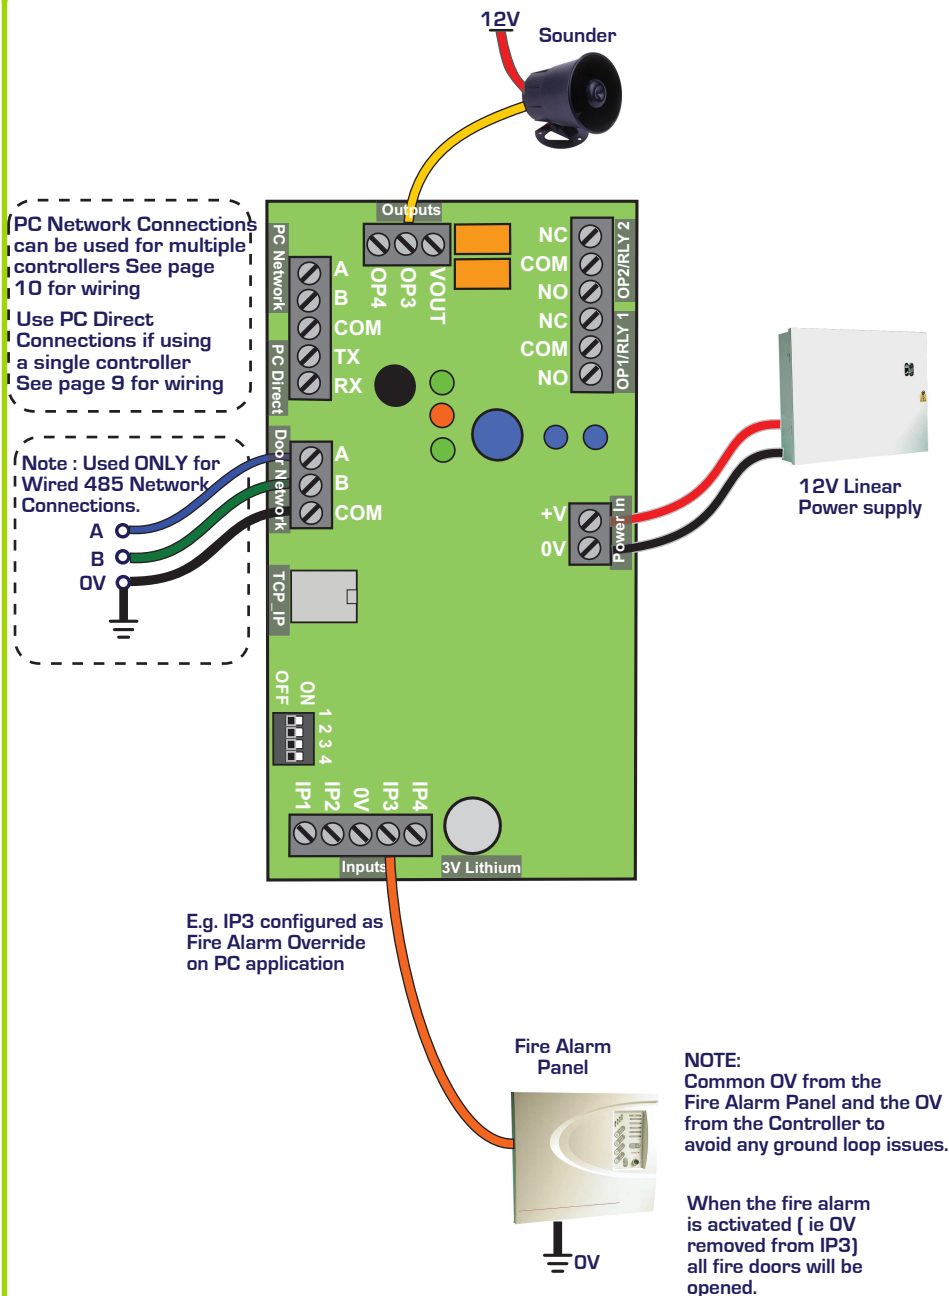


Phase 5 - Configuring Users

Step	Description
1.	Enable a User by ticking the 'Enabled' box for each User.
2.	Assign a Name to the User
3.	Assign a UserGroup from the drop-down menu. The Usergroup will determine the access levels for this User. Refer to section on page 18 'Configuring Access Levels' for information on User Groups.
4.	Assign a Card , PIN number or enroll FingerPrints for the User. Refer to section FingerPrint Enrolment on page 19 Click 'save' to transmit these changes to the Controller.

Phase 4 - Enrolling Door Controls


Step	Description
3.	Once all Door Controls are enrolled onto the network – go back to the PC application and click 'Secure Network' button. –this safeguards the systems and secures the network.
4.	<p>Select each Door on the application and configure individual settings such as Door Name, Timed Actions, Relay Times, Ajar Times, Door Option and Alarm Options etc.</p> <p>Timed Actions:</p> <p>IMPORTANT: A timezone must be selected in 'Timed Actions' for one of the options: Card and PIN, Any Card, Card or PIN , or PIN only.</p> <p>If all of these are set to 'inactive' then access will be denied for all cards and PINs on that Door Control.</p> <p>Example: To Enable PIN codes only on a Wi-PIN&Prox:</p> <p>Set the Timed Action "Card or PIN" to "Inactive" and set the Timed Action "PIN Only" to "All day,Every Day". This will grant access for PIN codes and deny access for cards and fobs.</p>

Network Diagrams for Single Controller

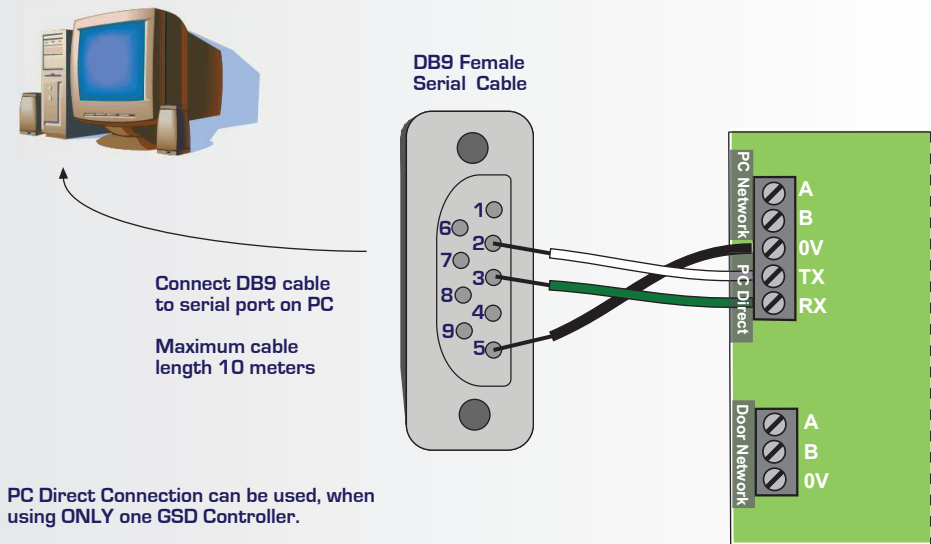

PC Direct Connection can be used, when using **ONLY** one GSD Controller.


Set the Direct address to **ALL** dip switches **OFF** (see below)

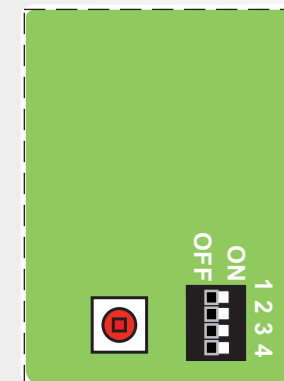

Direct Connect - All Dip Switches OFF

See page 11 on "Configuring GSD Controller Communication" to setup the application for serial communications

Network Diagrams for Multiple Controllers

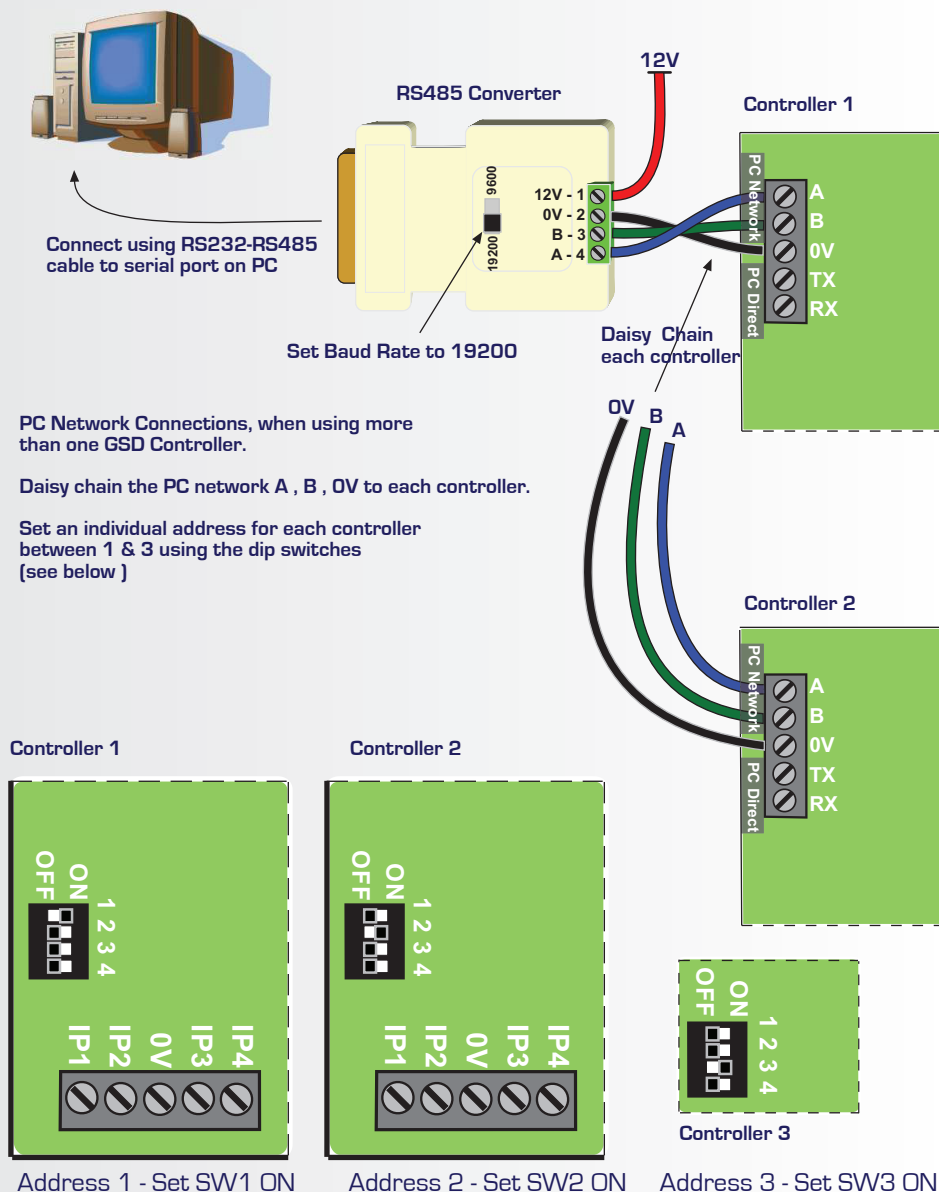

Phase 4 - Enrolling Door Controls

Step	Description
1.	<p>The controller is now ready to allow Door Controls to enroll onto the Network – Go to the 'Controllers' tab and Click on 'Wireless Network' and then click "Allow Doors to Join". This opens the network and starts the controller scanning for any new doors that do not already have an address – only Door Controls without an address can be enrolled.</p> <p>Note: For Wired 485 Door Controls, right click on the Controller on the right hand side of the application and select 'Manually Assign Address' from the drop down menu.</p> <p>Once all new Door Controls are found by the Controller they will all 'beep' with the number of the next available address/door position on the Controller.</p> <p>e.g. if door 2 is the next available address then all Door Controls will beep at the same time with 2 beeps. This is basically saying that any door can be assigned to this address – it's up to the installer to decide which one. Also – you will notice that the Key back light of the keypad Door Controls will be illuminated with the next available address as well.</p> <p>i.e. Key 2 will be illuminated for this example.</p>
2.	<p>Go to the Door control that you want to make door 2 on the network system [it should be beeping 2 times]. Press any key on this keypad and the system will automatically assign this door control to door 2 address on the system. Present a card if the Door Control is Prox Only.</p>
	<p>Note: All other Door Controls will now start beeping with the next available address i.e. '3 beeps' (address 3) in this instance and so on every time you enroll a new Door Control. The key back light will also correspond to each address as the system fills up. E.g. The 3 key will light up to indicate address 3.</p>

Phase 3 - Defaulting Door Controls


Step	Description
	All Door Controls should be installed at this point and powered up.
1.	<p>All Door Controls must be defaulted before joining a network. Note: Door Controls will be shipped with their factory default settings. Enter Engineer mode on each Keypad Door Control in the following way</p> <ol style="list-style-type: none"> Press X followed by 6666 Enter 55 -to default Press the tick to confirm – the keypad will now go through the process of defaulting itself. The process could take 20-30 seconds. The LED will flash once every second when it is complete Repeat the process for all keypad Door Controls <p>Enter Engineer mode on each Wi-Bio Door Control in the following way</p> <ol style="list-style-type: none"> Enter 6666 Enter 55 -to default Scan Finger to confirm – the Door Control will now go through the process of defaulting itself. The process could take 20-30 seconds. The LED will flash once every second when it is complete. Repeat the process for all Wi-Bio Door Controls <p>Enter Engineer mode on each Prox Only Door Control in the following way</p> <ol style="list-style-type: none"> Add a programming card to the Door Control by presenting a card twice on power-up. The security wing must be removed first! Present this new programming card to enter Engineer mode. Present the programming card again to select "Default mode". Present any other card once to default the Door Control. The process could take 20-30 seconds. The LED will flash once every second when it is complete

Configuring GSD Controller Communications


Step	Description
1.	On the "Controller" tab, set the "Connection - Type" to "Serial"
2.	On the "Settings" tab in the communications section, Select the Serial Port number from the drop-down list connected to the Controller.

Setting the GSD Controller address


The Controller Address is set by configuring the Dip switches as shown below.

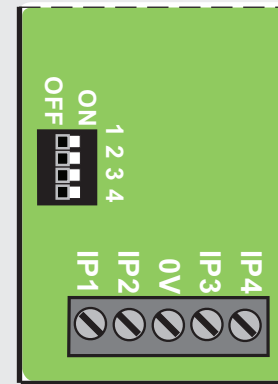

Direct Connect - All OFF

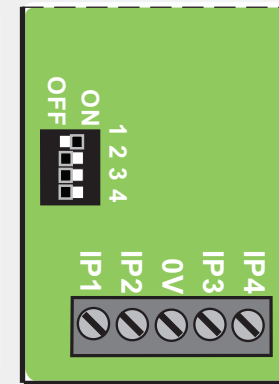


Address 1 - Set SW1 ON

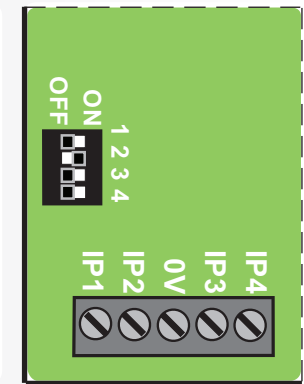

Address 2 - Set SW2 ON

Note: Address 3 - Set SW3 ON only

Restoring Factory Settings

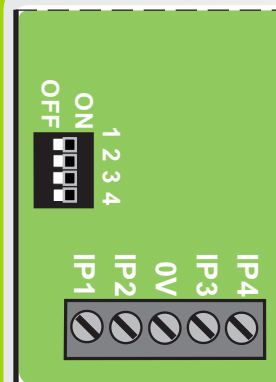

To restore the factory default setting, Set **ALL** Dip Switches 1,2,3 & 4 to the ON position and then power-up the GSD Controller.

Example: All Dip Switches are set to the ON position.

Note: Factory Default settings will be restored after powering up the controller with All dip-switches ON. The dip-switches should then be set to the controller address as shown above in section "Setting the GSD controller address"

Phase 1 - Setting up the GSD Controller

Step	Description
1.	Install the GSD Controller and power up
2.	Begin by Defaulting/Restore Factory Settings on the controller via the dip switch settings (see instructions on page 11)
3.	Important! Once powered up and the controller has completed the default the process – reset the dip switches to the correct address positions. (see instructions on page 11)
4.	Follow instructions on the CD provided to install the GSD PC application. To download the latest drivers, enter the following link in your web browser. http://www.globalsecurity.ie/userfiles/files/GSDWin Access en-US.zip Note: Make sure the USB enrollment reader is not connected to the PC before the GSD application is installed.
5.	Launch the application: A. Launch the application by clicking the GSDWin icon on the desktop. The "Site Database Management" will appear. B. Click on "Create New Site", then click "Create New Wi-Plus Site" and save the name of the new installation site. The application will then launch. C. Log in to the application as the Engineer (not the administrator) with the password 6666. D. Connect to the GSD Controller. Refer to page 9 -13 for connection diagrams. For a serial connection , set the correct com port number by going to the "Settings" tab and choosing the com port that the serial cable is connected to, from the drop-down list in the communications section. E. The Controller icon will change colour from gray (off-line) to green (on-line) to show that the Controller is communicating with the application. F. Go to the 'Current Events' tab to view the current log messages from the Controller

Phase 2 - Configuring the GSD Controller

Step	Description
1.	Open the 'Doors' tab in the main menu to add the required number of new doors to be part of this network. One door will already be added by default. Click on the "+" button to add new doors. "-" to remove doors.
2.	Make sure all desired doors are "Enabled" and then click "Save".
3.	Open the Settings Tab and do a "Configuration Download" to the Controller – this gives the Controller a clean set of instructions before beginning to enroll doors onto the network.
4.	Create a New Wireless Network. WARNING! A New Network should only be created on first installation. Creating a new network will overwrite any existing network information and any enrolled Door Controls will be un-enrolled. All Door Controls will have to be defaulted and re-enrolled on the new network that has just been created! A new network is now ready to be created. Go to the 'Controllers' tab and Click on 'Wireless Network' and then click on 'Create New Network'. Click Yes on the pop-up to proceed. Note: It will take about 20 - 60 seconds to complete. a pop-up will appear when the network has been created.