

1 Introduction





Fig. 1

2 RELAY RECEIVER HIVE-1000

The HIVE-1000 receiver offers the latest technology. The receiver has a built-in Bluetooth module that allows bi-directional communication with a smartphone via the HIVE-1000 mobile App for either iOS or Android operating systems.

The App facilitates managing receiver settings and pairing transmitters. The HIVE-1000 receiver operates at both 318 MHz and 433 MHz frequencies and can do so simultaneously allowing for up to 1,024 total remotes split equally between both frequencies. (512 remotes at 318 MHz and 512 remotes at 433 MHz)

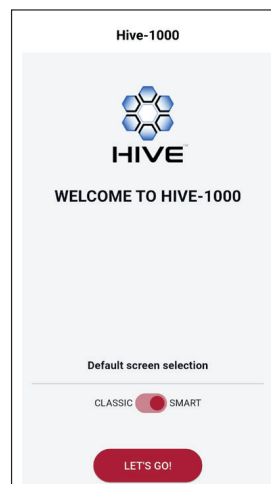

2 Technical Specifications

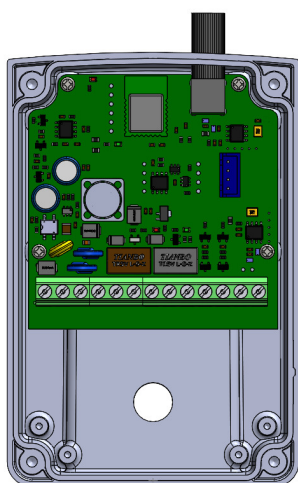


Fig. 2

Receiver type:	Superheterodyne.
Demodulation:	AM/ASK.
Receiver bandwidth:	330 kHz
Operating frequency:	433.92 Mhz / 318 MHz
Sensitivity (for good signal):	-116 dBm @ 433 MHz -111 dBm @ 318 MHz
Input load:	50 Ohm.
Power supply :	12 to 24 Vac/dc.
Current consumption (@12Vdc)	160 mA (max)
N° of relays:	2 x (NO / NC).
Relay contact rating:	1 A @ 30 Vdc, 0.5 A @125 Vac
Max relay switching voltage:	125 Vac / 60Vdc
Min relay contact current:	1 mA @ 5V
Transmitter Memory capacity:	512 @ 318 MHz + 512 @ 433.92 MHz
Security protocols	Linear MegaCode® Keeloq® Hopping code
Max. number of facility codes:	4
Operating temperature:	-22 to 158 °F
Dimensions (Fig. 2):	4.8 x 3.2 x 1.6 inches
Weight:	5.6 ounces

The HIVE-1000 is bluetooth enabled and controlled via a smartphone app (details in Section 7)



Bluetooth®



3 Mounting

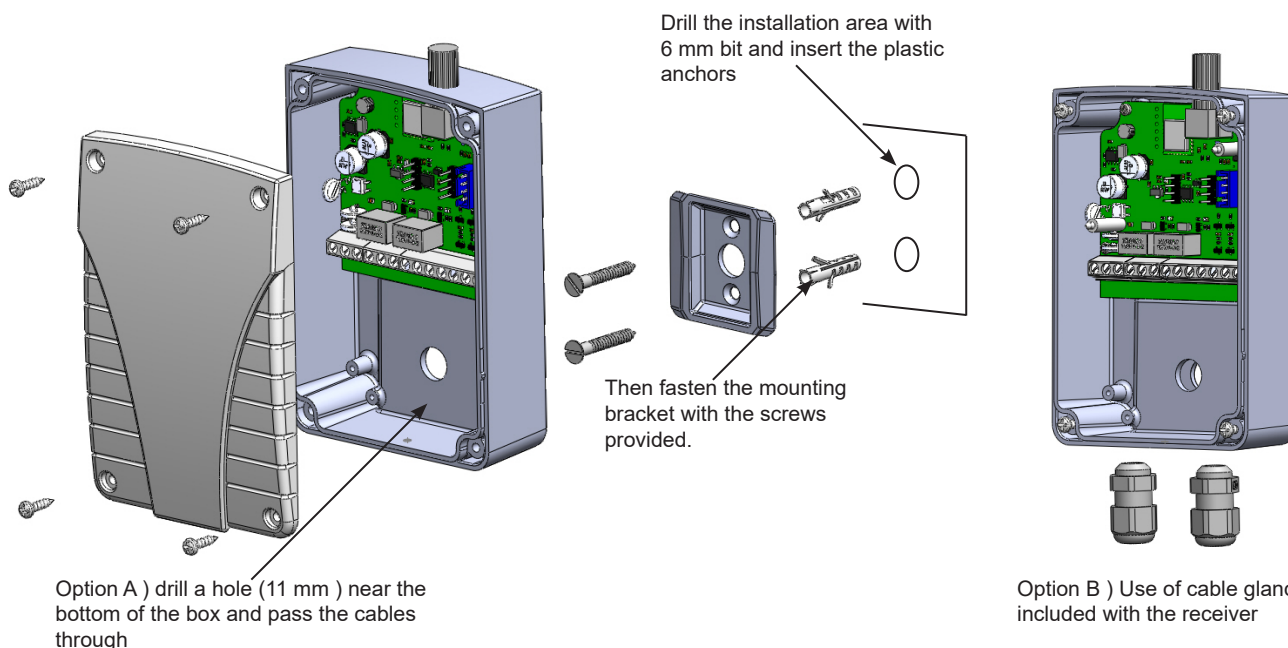


Fig. 3

4 General operation

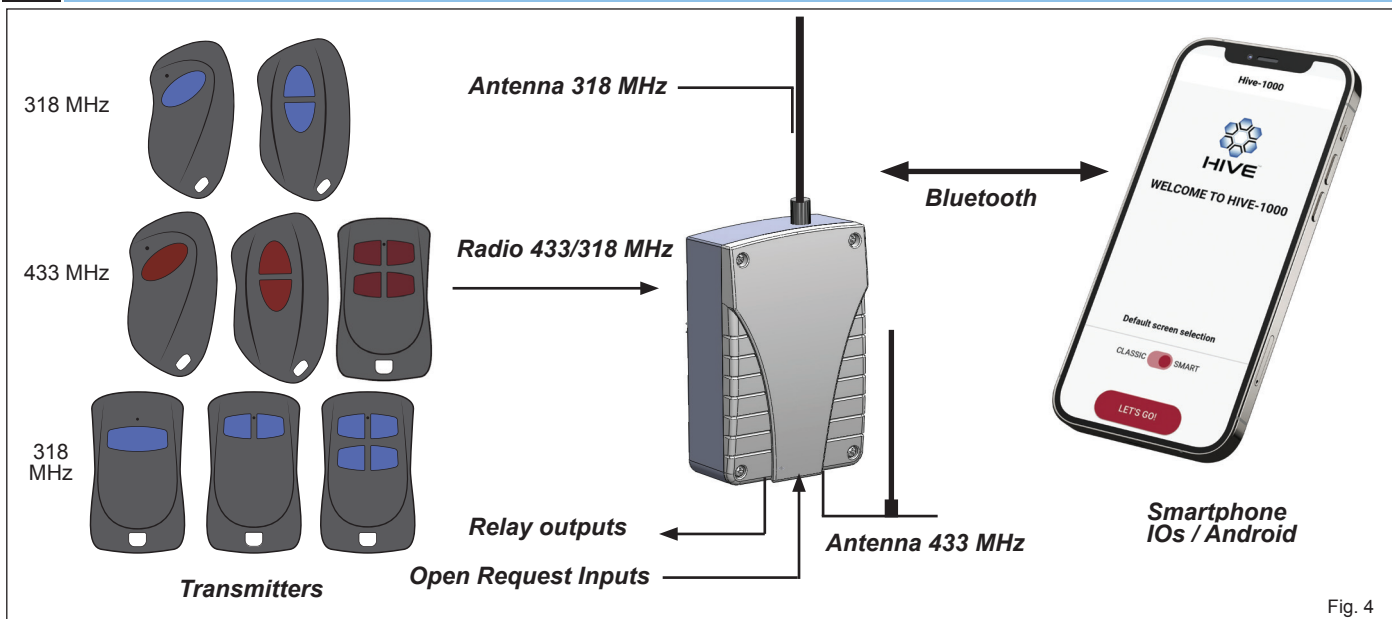


Fig. 4

5 Layout & Wiring

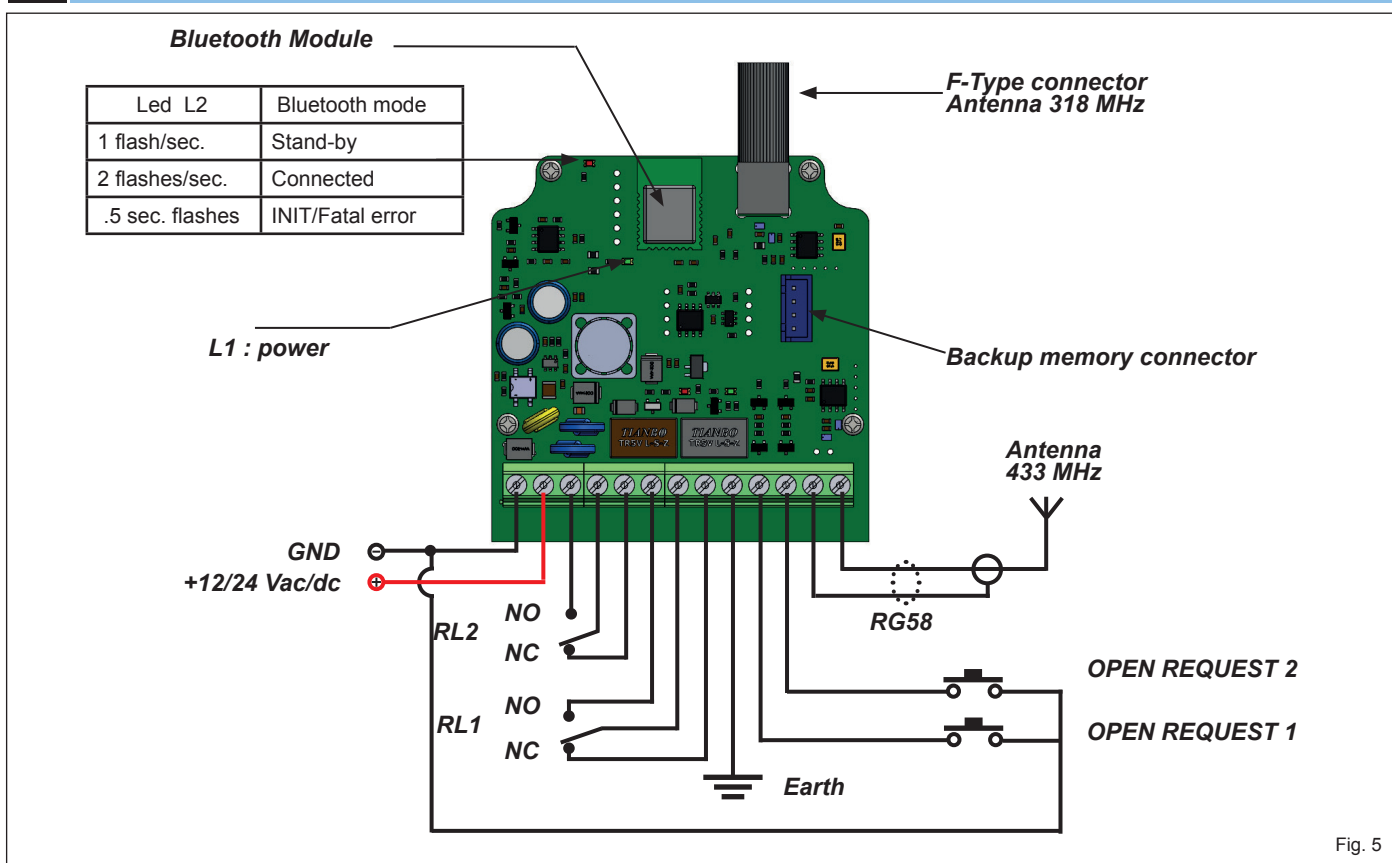


Fig. 5

6 Warnings



The receiver placement is very important for the best operation of the system. Place the receiver far from interference sources such as big magnetic fields or radio emission sources. The installation and the positioning of the antenna is very important as well. Before installing the antenna it's advisable to do on site testing.

NOTE: The distance between 2 receivers must be at least 5 ft.

- The equipment must be powered by a device that provides a safety extra low voltage (SELV) type LPS (Low Power Source);
 - There must be a suitable disconnecting device to the current drawn by the receiver (160mA max @ 12Vdc).
- The equipment is manufactured in compliance with the provisions of European Directive 2006/95 / EC, 2004/108 / EC, 99/05 / EC and from that stated in the standard EN 60950-1.

7 APP download and connection to the Smartphone

Management of the receiver can only be done by using a smartphone connected via Bluetooth. For this reason the first step is to download the proper App on your smartphone from the Google Play or Apple store.

Once the App is installed, the software will scan for devices within Bluetooth range of the smartphone and will initiate communication with the receiver. When the connection is made, the RED led L2 of the receiver starts flashing rapidly

The App must be downloaded from the following platforms:

Android: Link




iOS: Link



Click on the links or scan the QR codes.

7.1 Installing and permissions

Once downloaded, you will be asked to accept the “Bluetooth” permissions. Without this, the application will not be able to locate or communicate with the receiver.

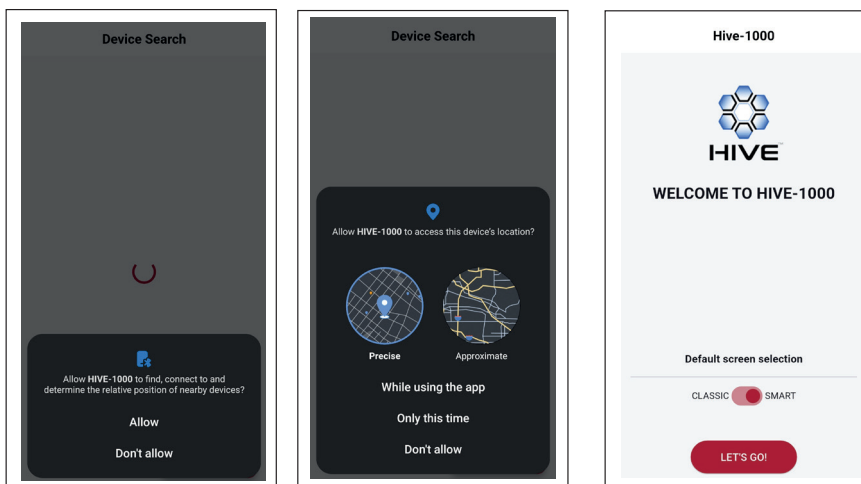


Once downloaded the App, takes you to the welcome screen

7.2 Device Connection

To connect to the device, press “Device Search” button and select receiver. The scanning range is limited by the Bluetooth technology up to 30 meters (98.5 feet).

Signal strength depends on the position of the receiver and whether the communication is unobstructed or passes through obstacles. **The Bluetooth communication is one-to-one, so if someone else is connected to the receiver, it is not possible to detect it with the scanning function or to connect to it.** The receiver comes from the factory with the name “APHV”. Once connected, you can change the receiver name (up to 15 characters).

Once connected, you are requested to type the login password: **Administrator or Installer**

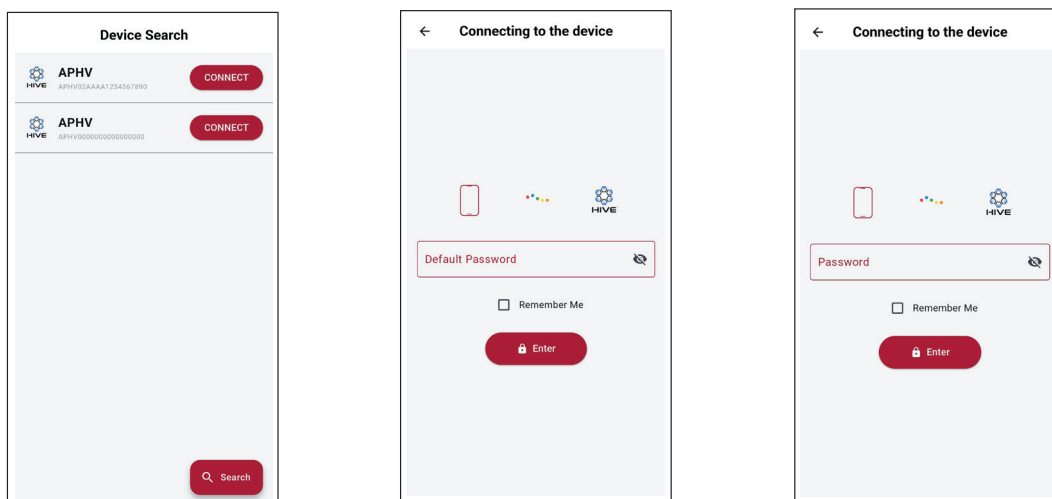

7.3 Passwords

Each device is protected by a password.

There are two different passwords preset on the receiver: one for the Administrator and one for the Installer. The factory default passwords are as follows:

Administrator: 11111


Installer: 00000

It is highly recommended to change the passwords after the initial activation/access of the device. Once the password has been changed, after the first login with the default password, you are requested to access with the new password chosen.

The difference between Installer and Administrator level is defined by who can change and set new password values. An administrator can set the password for himself and for the Installer, the Installer can only set a password for himself.

If “Default Password” appears in **RED**, in the password entry screen, it means that at least one of the two passwords has a factory default value.

If “Remember me” is selected, the App will store the password. The next time you connect with HIVE-1000, the App will automatically populate this password.

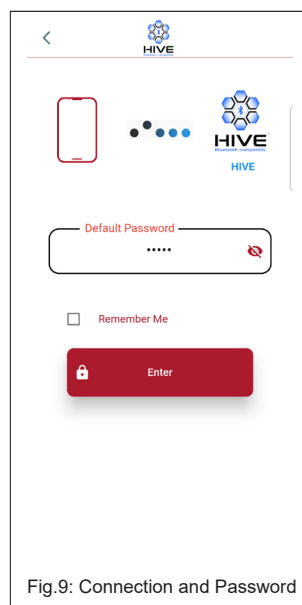


If the user has forgotten their password, they should contact Transmitter Solutions technical support

8 Device functions


8.1 Dashboard

After a successful login the user can choose between 2 dashboards using the toggle switch indicated below.

NOTE : the default screen mode can be set in the DEVICE SETTING menu.

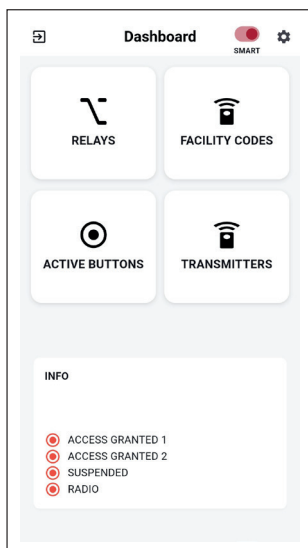

“SMART” Dashboard

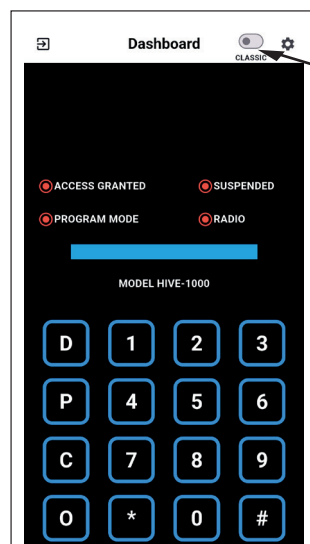

“CLASSIC” Dashboard

This switch allows the user to toggle between the **SMART** and **CLASSIC** Dashboards.


- The **SMART** dashboard allows the management of both 318 MHz and 433 MHz remotes controls and more settings of the receiver.

- The **CLASSIC** dashboard shows Commands, symbols and procedures to do manual entry.

8.1.1 SMART Dashboard

The SMART Dashboard allows:

- management of remote controls 318 MHz Linear® MegaCode®
- management of remote controls 433 MHz Keeloq® hopping code
- setting of relays operating mode
- setting of the device name
- back/restore of the remote controls database
- change of the Administrator and Installer password
- restore the device to factory setting

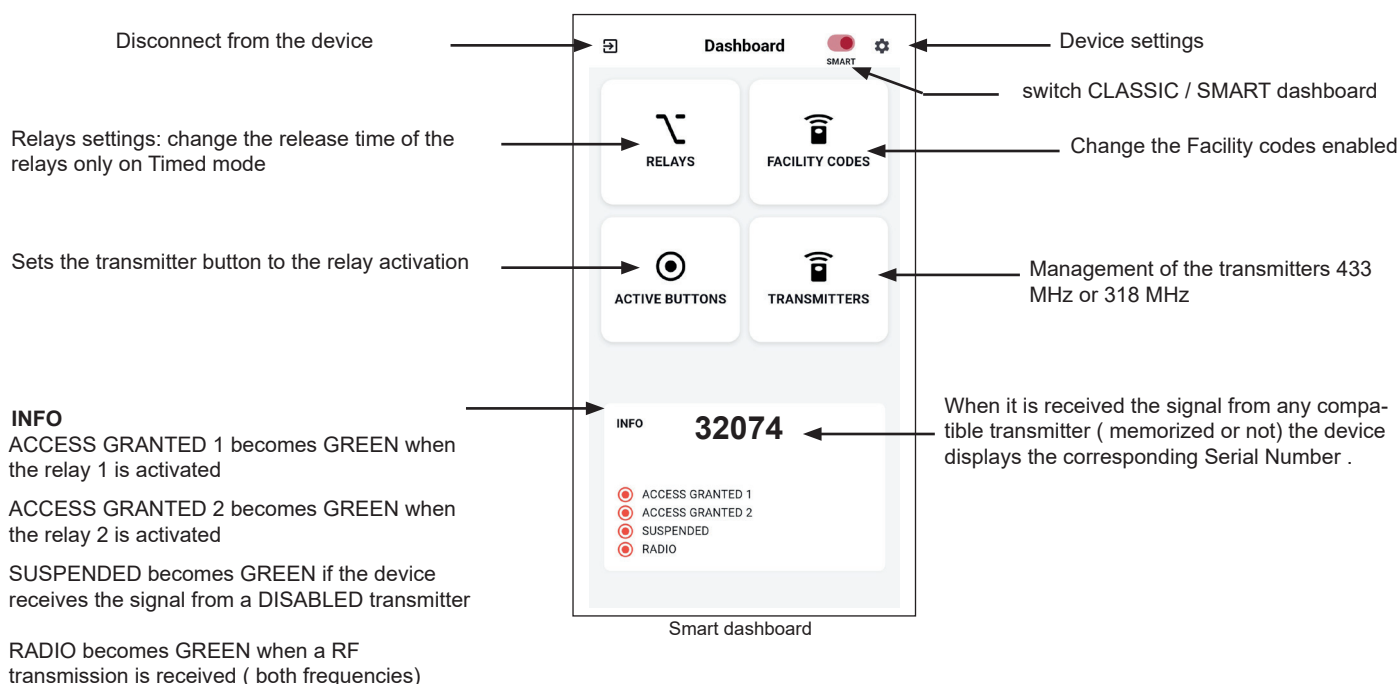

8.2 RELAYS

Relay Settings

Relay 1 Time
seconds
1
Time: 1 - 120s

Relay 2 Time
seconds
1
Time: 1 - 120s

Save configuration

The operating mode of the relays is TIMED or TOGGLE.

For transmitters operating in "Timed mode" use the 2 options to set the release time of the relay (1 or 2)

Time range : 1 - 120 sec.

8.3 FACILITY CODES

FC Settings

FC 1
value
1
Value: 0 - 255

FC 2
value
6
Value: 0 - 255

FC 3
value
9
Value: 0 - 255

FC 4
value
58
Value: 0 - 255


Save configuration

The option Facility codes allows to set up to 4 different Facility codes.
Range : 0 - 255.

This setting creates a filtering that allows the relays activation only to transmitters with the proper Facility code.

If the 4 values are 0, all facility codes will be ignored.

8.4 ACTIVE BUTTONS

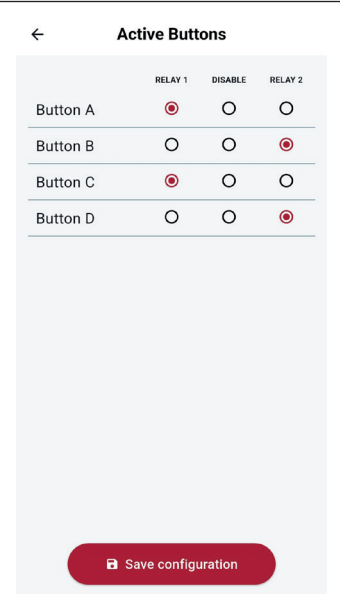


The Active buttons function assigns to the button of the transmitter the corresponding relay.

The example shows the following assignment:


- Button A : activates Relay 1
- Button B : activates Relay 2
- Button C : activates Relay 1
- Button D : activates Relay 2.

If the option “disable” is selected the transmitter does not activate any relay.

8.5 ADD TRANSMITTERS

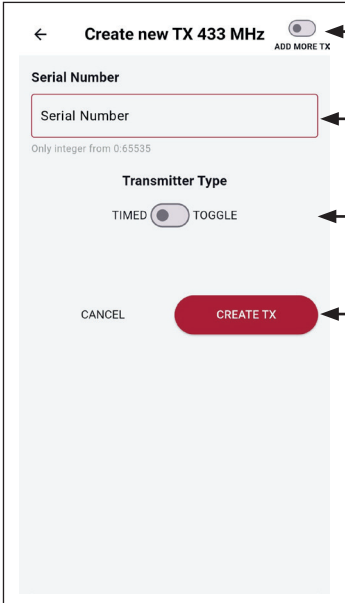



- Switch to enable block enroll
- Type the Serial Number of the transmitter to add [0 - 65535]
- Specify the operating mode of the relay: timed or toggle
- Confirm button

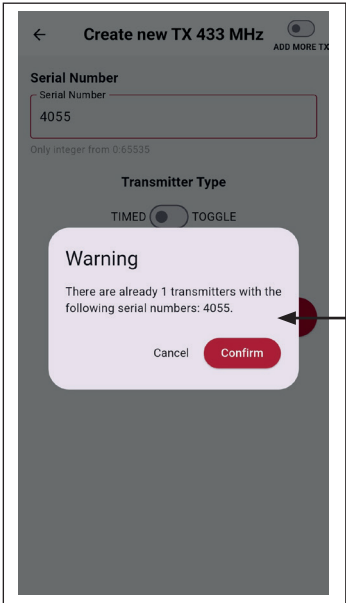

Warning message displayed when trying to store a transmitter already in memory

8.5.1 MANAGING TRANSMITTERS


Select the option “Transmitters” to manage the transmitters choosing 433 MHz or 318 MHz. The software displays the list of the transmitters memorized, showing serial number (S/N), relay activated and the operating mode of the relay (Timed or Toggle).

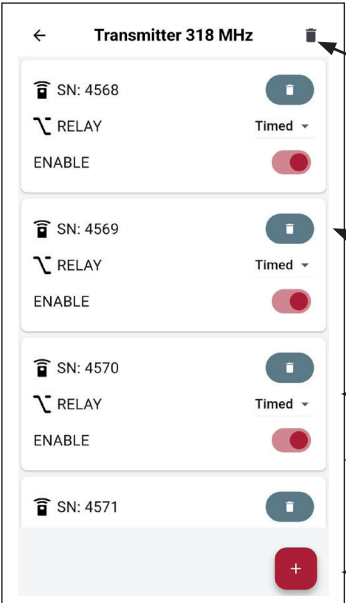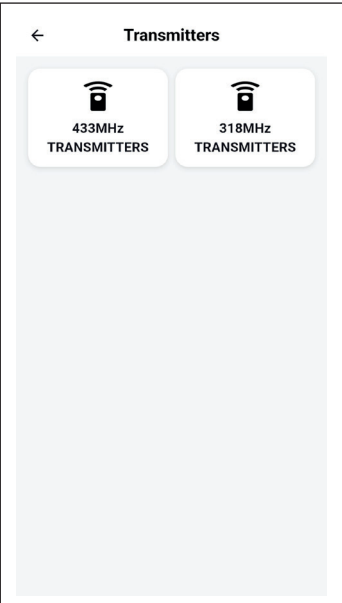



- Press to delete multiple transmitters using the S/N
- Press to delete a single transmitter.
- Press to change the operating mode of the relay from timed to toggle
- Slide to disable the transmitter
- Press [+] to add more transmitters

8.5.2 SEARCH BAR


The search bar displays a list of all memorized transmitters, with their serial number, for both 433 and 318 MHz

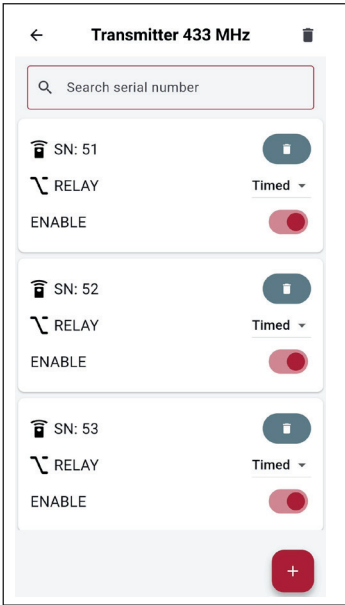

Searching TX with S/N=100

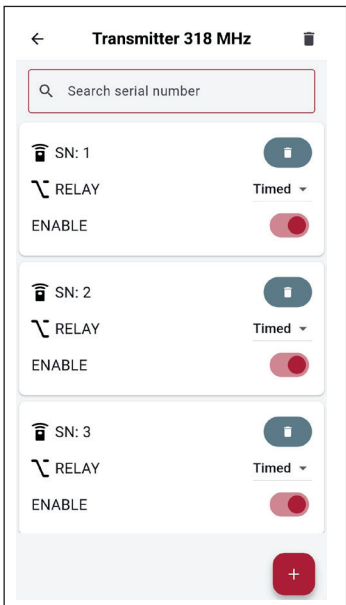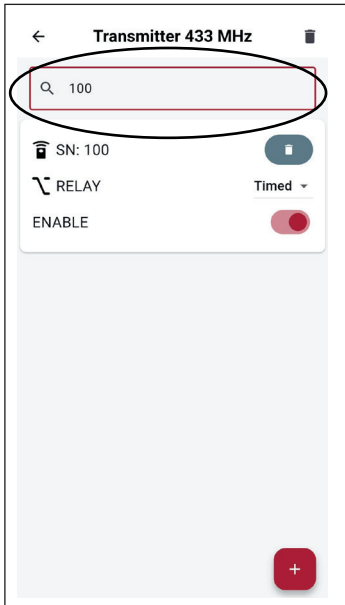

Searching TX with S/N=4660

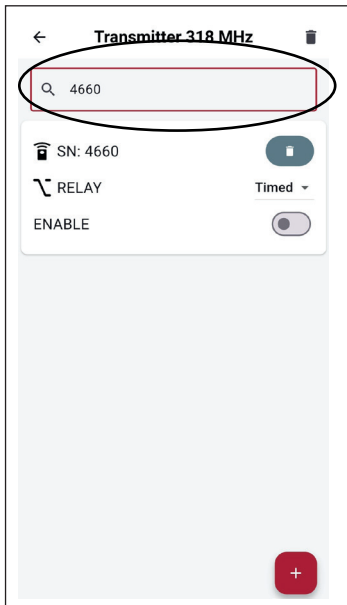

8.5.3 BLOCK ENROLL

Allows block enrollment of multiple transmitters by typing the first and the last serial number of the block

←

Create new TX 433 MHz

ADD MORE TX

Serial Number Start

Serial Number Start

Only integer from 0:65535

Serial Number Stop

Serial Number Stop

Only integer from 0:65535

Transmitter Type

TIMED

TOGGLE

CANCEL

CREATE TXs

Switch active

Type the Serial Number of the **first** transmitter to add

Type the Serial Number of the **last** transmitter to add

Specify the operating mode of the relay: this will be valid for the full block of transmitters

Confirm button

8.5.4 REMOVE SINGLE TRANSMITTER (433 MHz or 318 MHz)

←

Remove TX 433 MHz

REM MORE TX

Serial Number

Serial Number

Only integer from 0:65535

CANCEL

REMOVE TX

Type the Serial Number of the transmitter to remove

Confirm button

←

Remove TX 318 MHz

REM MORE TX

Serial Number

Serial Number

Only integer from 0:65535

CANCEL

REMOVE TX

8.5.5 REMOVE A BLOCK OF TRANSMITTERS (433 MHz or 318 MHz)

←

Remove TX 433 MHz

REM MORE TX

Serial Number Start

Serial Number Start

Only integer from 0:65535

Serial Number Stop

Serial Number Stop

Only integer from 0:65535

CANCEL

REMOVE TXs

Switch to enable block deletion of transmitters

Type the Serial Number of the **first** transmitter to delete

Type the Serial Number of the **last** transmitter to delete

Confirm button

←

Remove TX 318 MHz

REM MORE TX

Serial Number Start

Serial Number Start

Only integer from 0:65535

Serial Number Stop


Serial Number Stop

Only integer from 0:65535

CANCEL

REMOVE TXs

8.6 DEVICE SETTINGS

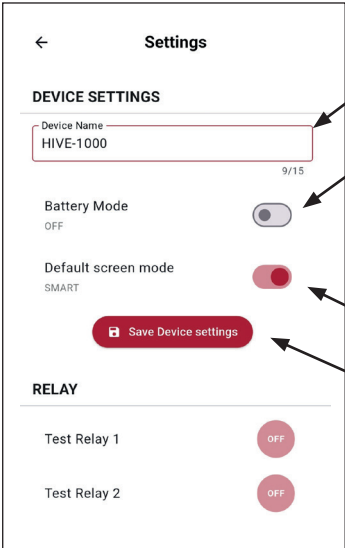

← Settings

DEVICE SETTINGS

Device Name
HIVE-1000 9/15

Battery Mode
OFF

Default screen mode
SMART

Save Device settings

RELAY

Test Relay 1 OFF

Test Relay 2 OFF

Type the name of the device

If the receiver is battery powered, set the system in Battery mode.

BATTERY MODE: when selected, the system considers 2 threshold levels for the power under which the receiver stops working, to avoid unstable situations.

Power supply 12 Vdc ----> Threshold = 11.2 Vdc
Power supply 24 Vdc -----> Threshold = 20 Vdc



Set the Default screen mode after the login (Classic or Smart)

Press the button to save the settings.

Commands to test the operation of the relays: Click to activate, click again to deactivate

8.7 MEMORY BACKUP / RESTORE

The full data-base containing the s/n of the remote controls memorized and all the settings of the receiver can be saved into an external memory or restored from an external memory that must be plugged-in on the proper 4-pin connector on the receiver.

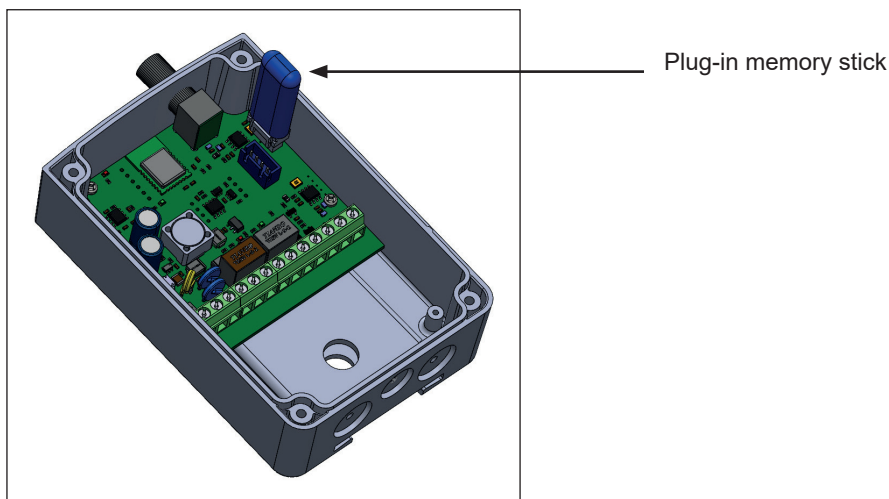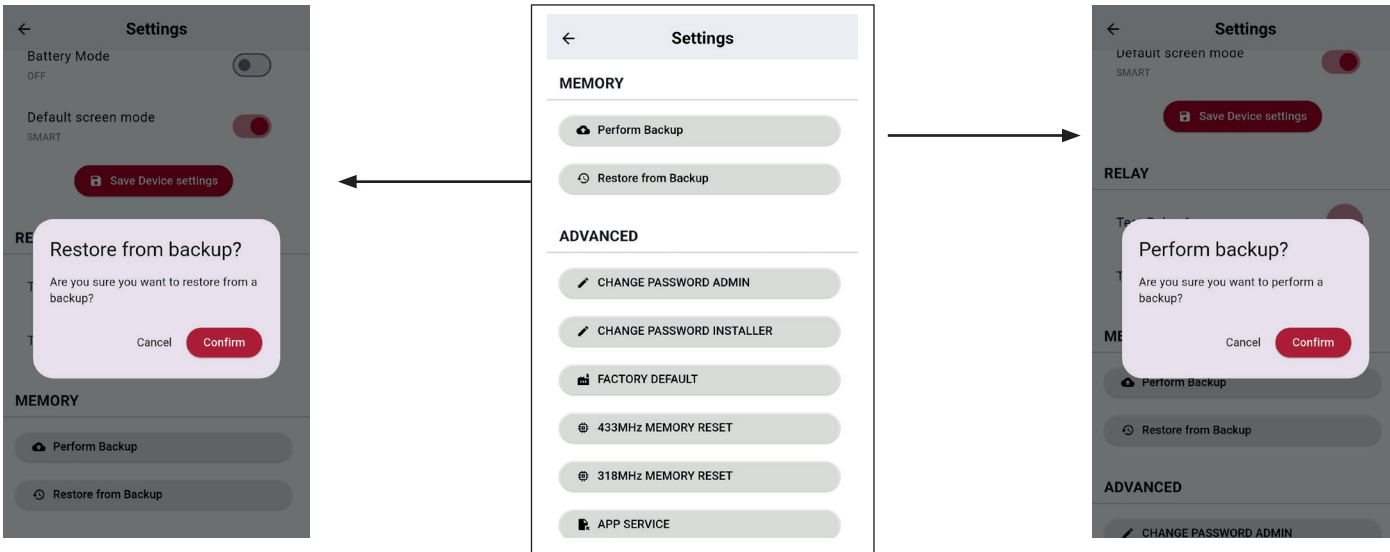← Settings

Battery Mode
OFF

Default screen mode
SMART

Save Device settings

Restore from backup?

Are you sure you want to restore from a backup?

Cancel Confirm

MEMORY

Perform Backup

Restore from Backup

ADVANCED

CHANGE PASSWORD ADMIN

CHANGE PASSWORD INSTALLER

FACTORY DEFAULT

433MHz MEMORY RESET

318MHz MEMORY RESET

APP SERVICE

← Settings

Default screen mode
SMART

Save Device settings

RELAY

Test Relay 1

Test Relay 2

MEMORY

Perform Backup

Restore from Backup

ADVANCED

CHANGE PASSWORD ADMIN

Perform backup?

Are you sure you want to perform a backup?

Cancel Confirm


Press "Restore from Backup" to upload the data from an external plug-in memory.

WARNING: This operation will overwrite the existing database

Press "Perform Backup" to save the full data base on the external plug-in memory

8.8 ADVANCED SETTINGS

The password of the Administrator can be changed only by the administrator.
The password of the Installer can be changed by the Administrator or by the Installer.

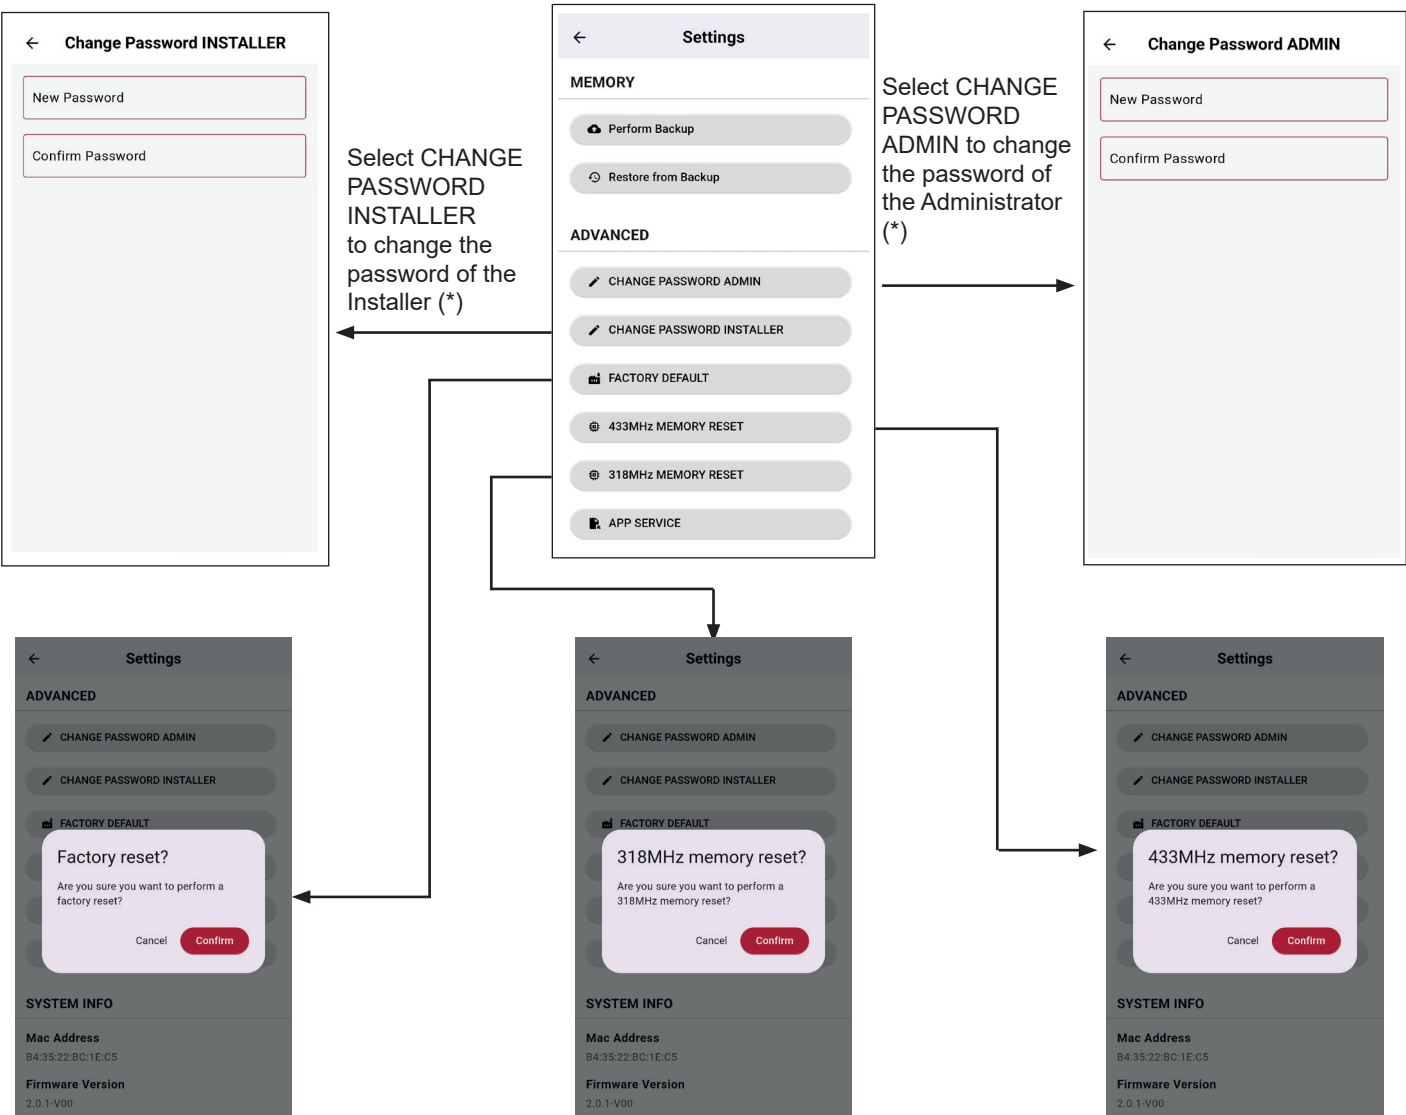


Factory reset brings the device to the factory settings with the exclusion of the passwords (see paragraph 7.3.1) and the transmitter data-bases for which there are specific deleting commands (see next images).

Deletes all the transmitters 318 MHz

Deletes all the transmitters 433 MHz


8.9 DISCONNECT

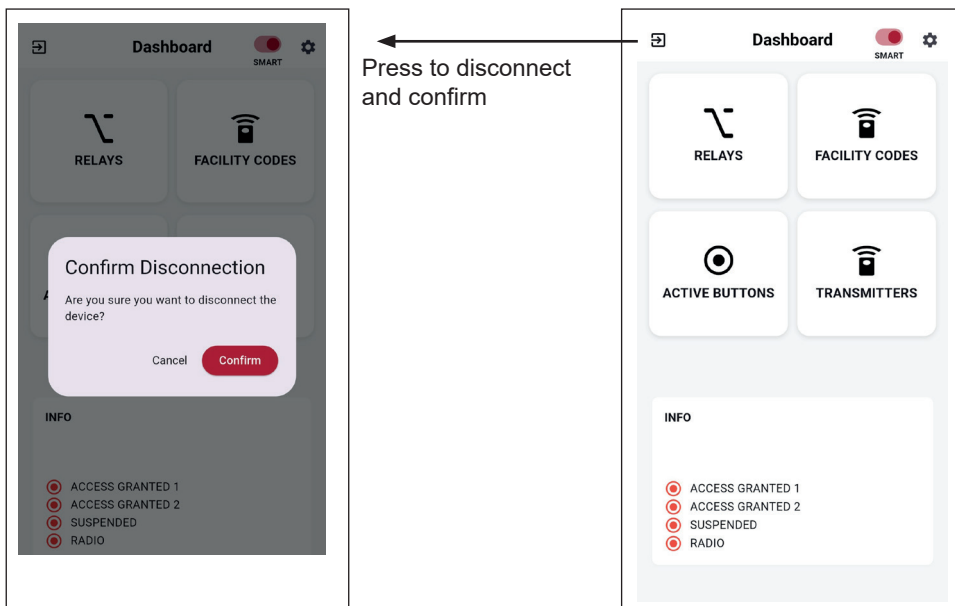

9 Open Request

The 2 inputs (C-NO) of open request, activate directly the 2 relays if the contacts are shorted to GND:

- Open Request 1 activates Relay 1
- Open Request 2 activates Relay 2

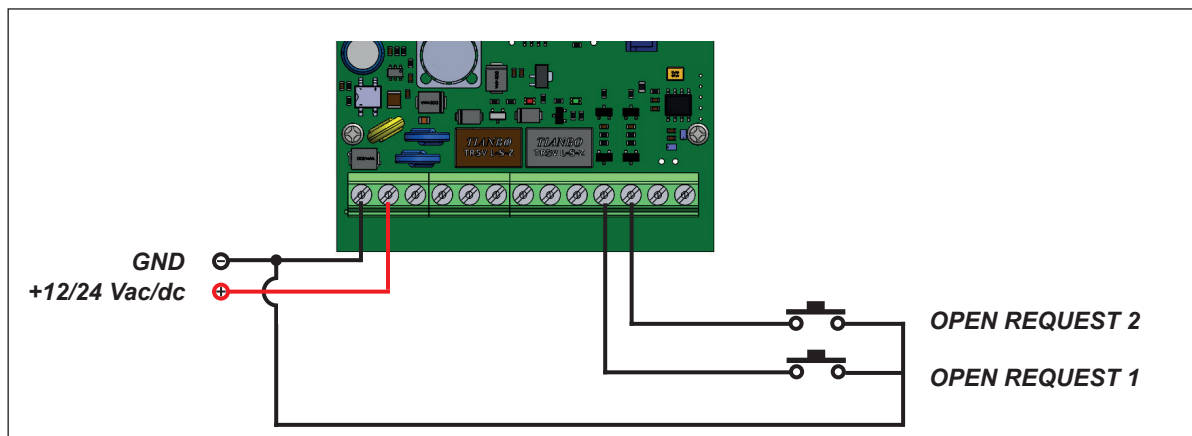


There are two separate programming methods to assist the user in programming the HIVE-1000 receiver: CLASSIC Programming and SMART Programming (described beginning in section 8.1.1)

The "CLASSIC" programming screen will be beneficial for those familiar with the programming of other receivers.

10.1 CLASSIC Dashboard


Press "P" button for 3 sec. to enter in the program mode and follow the physical manuals.

The CLASSIC Dashboard operates as shown below:

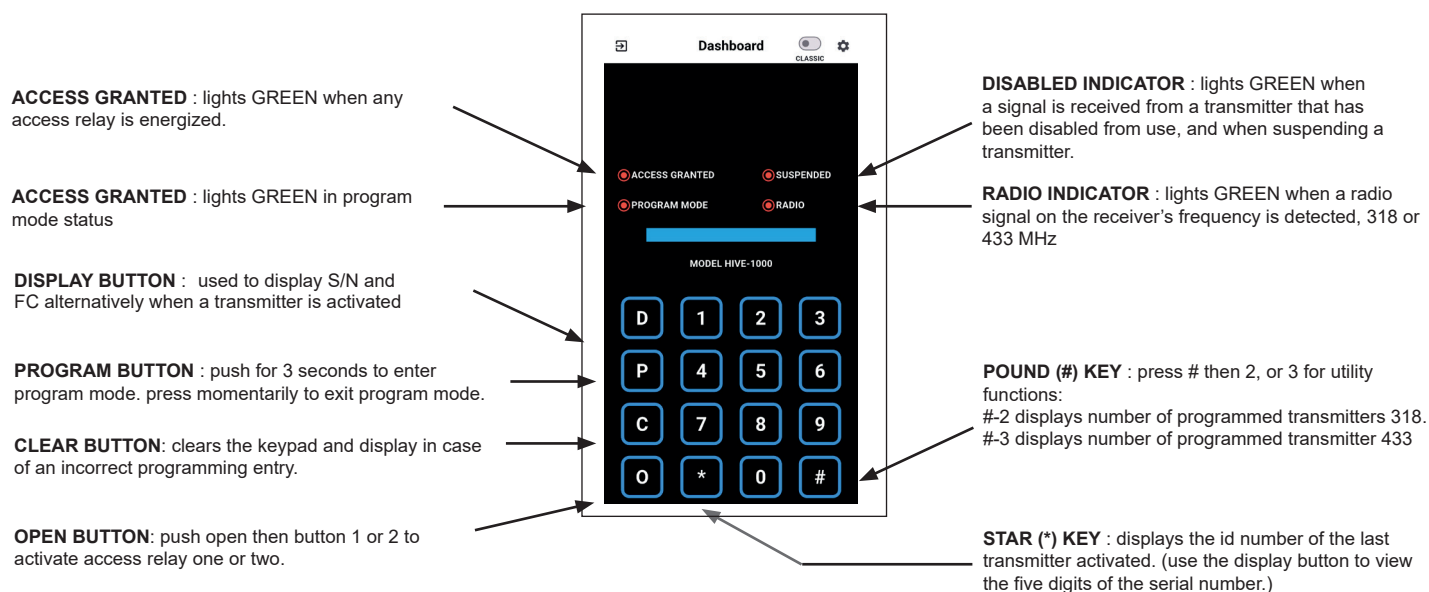


10.1.1 CLASSIC Programming

Adding 318/433 MHz TX

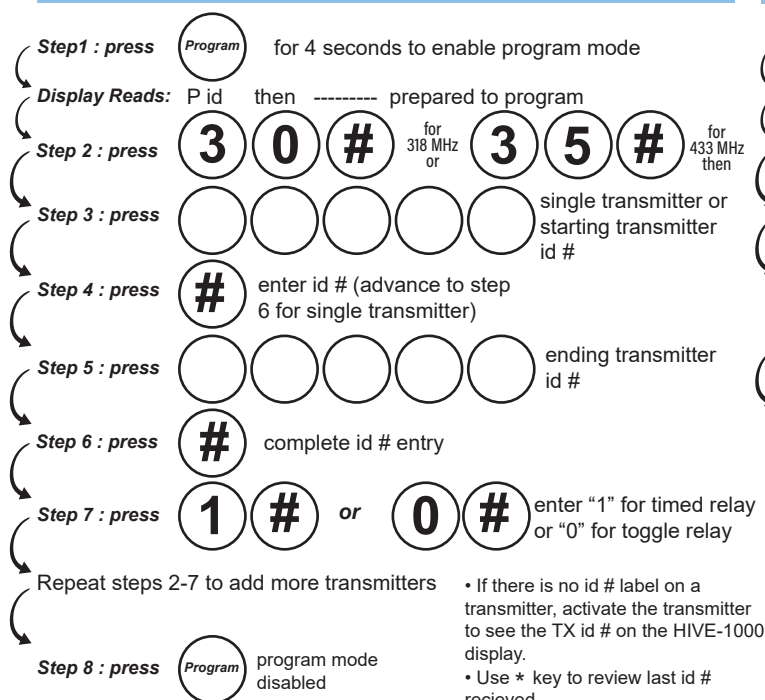



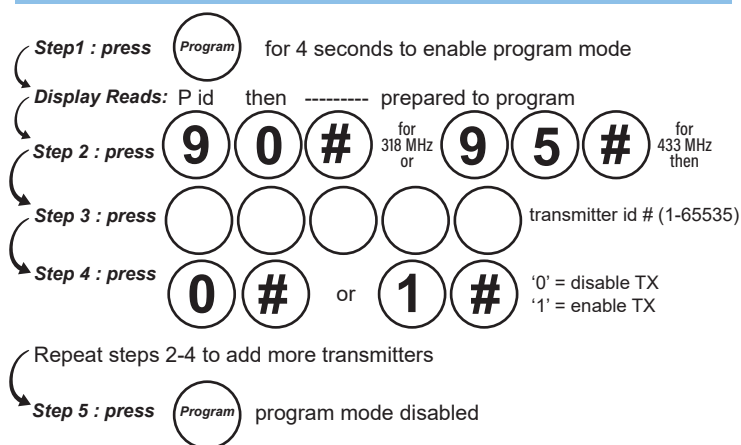













Enable/Disable 318/433 MHz TX























NOTES:

- 1: Disabled transmitters will not trigger any access relay, the disabled led will light instead
- 2: Activated transmitters can trigger any access relay














Delete 318/433 MHz TX

- Step 1 : press**  for 4 seconds to enable program mode
- Display Reads:** P id then ----- prepared to program
- Step 2 : press**    for 318 MHz or    for 433 MHz then
- Step 3 : press**    
- Step 4 : press**    
- Display Reads :** dEL then ----- memory clear
- Step 5 : press**  program mode disabled

Delete all 318/433 MHz TX

- Step 1 : press**  for 4 seconds to enable program mode
- Display Reads:** P id then ----- prepared to program
- Step 2 : press**    for 318 MHz or    for 433 MHz then
- Step 3 : press**     
- Step 4 : press**  enter id # (advance to step 6 for single transmitter)
- Step 5 : press**     
- Step 6 : press**  complete id # entry
- Display Reads:** dEL ----- transmitters delete
- Repeat steps 2-6 to remove more transmitters
- Step 8 : press**  program mode disabled














Relay activation time

- Step 1 : press**  for 4 seconds to enable program mode
- Display Reads:** P id then ----- prepared to program
- Step 2 : press**    relay activation time function number
- Step 3 : press**   or   '1' = relay K1
'2' = relay K2
- Step 4 : press**     enter '1' to '120' seconds for the relay activation time
- Repeat steps 2-4 to program another relay
- Step 5 : press**  program mode disabled

NOTES:

2 seconds is factory default relay activation time












Set transmitter buttons

- Step 1 : press**  for 4 seconds to enable program mode
- Display:** P id then ----- prepared to program
- Step 2 : press**   
- Step 3 : press**   or   '1' + # = activate relay K1
'2' + # = activate relay K2
- Step 4 : press**   or   enter '1' to enable button
enter '0' to disable button
- Repeat steps 2-4 for programming another button
- Step 5 : press**  exit program mode

NOTES:

1. The factory default setting only allows the 'A' transmitter button to activate relay K1
2. The button settings will be used by all programmed transmitters

Set facility codes

- Step 1 : press**  for 4 seconds to enable program mode
- Display:** P id then ----- prepared to program
- Step 2 : press**    facility code function number
- Step 3 : press**  
- Step 4 : press**    
- Repeat steps 2-4, as needed, for each of the four receiver facility code locations
- Step 5 : press**  program mode disabled

NOTES:

1. Factory default setting is '0'. A facility code setting of '0' allows receiver to accept all transmitters regardless of their facility code

